


[별표 1] (제4조제1항제1호 관련) <개정 2019.9.24., 2024.8.28.>

접합부 나사의 기준치수 및 공차

(단위 : mm)

호칭	구 분		수 나 사			암 나 사			A	N	P	a	b	c	<삭 제>	DP	G
	나 사 산 수	소방용 수통과 지 림	바 지 지 림 D A	유 효 지 림	끌지름 d	유 효 지 림	안지름 D B	끌지름 D									
25	8산/ 25.4mm	25.4	35.230 -0.305 -0.869	33.167 -0.305 -0.587	31.105 -0.305 규정없음	33.167 +0.282 +0	31.105 +0.738 +0	35.230 +규정없음 +규정없음	0	8.5	5	1.5	10.5	16±0.5	<삭 제>	37	15
40	9산/ 25.4mm	38.1	50.800 -0.058 -0.585	48.971 -0.058 -0.344	47.752 -0.455 규정없음	48.971 +0.392 +0	47.752 +0.924 +0.010	50.8 +규정없음 +규정없음	1.5	8.5	5	1.5	10.5	16±0.5	<삭 제>	52	15
65	7.5산/ 25.4mm	63.5	77.788 -0.068 -0.663	75.588 -0.068 0.399	74.122 -0.545 규정없음	75.588 +0.478 +0	74.122 +0.974 +0.010	77.788 +규정없음 +규정없음	1.5	16	6.5	3	16.4	25.4±0.5	<삭 제>	80	24
75	6산/ 25.4mm	76.2	92.428 -0.381 -1.295	89.677 -0.381 -0.838	86.926 -0.381 규정없음	89.677 +0.457 +0	86.926 +1.068 +0	92.428 +규정없음 +규정없음	2	18	7	3	19.6	28.6±0.5	<삭 제>	96	27
90	6산/ 25.4mm	88.9	108.303 -0.508 -1.422	106.552 -0.508 -0.965	104.801 -0.508 규정없음	106.552 +0.457 +0	104.801 +1.068 +0	108.303 +규정없음 +규정없음	2	18	7	3	19.6	28.6±0.5	<삭 제>	112	27
100	4산/ 25.4mm	101.6	127.912 -0.635 -1.905	123.787 -0.635 -1.270	119.662 -0.635 규정없음	123.787 +0.635 +0	119.662 +1.552 +0	127.912 +규정없음 +규정없음	2	18	7	3	19.6	28.6±0.5	<삭 제>	131	27
115	4산/ 25.4mm	114.3	146.962 -0.635 -1.905	142.837 -0.635 -1.270	138.712 -0.635 규정없음	142.837 +0.635 +0	138.712 +1.552 +0	146.962 +규정없음 +규정없음	2	21	7	4	22.5	31.8±0.5	<삭 제>	150	30
125	4산/ 25.4mm	127	159.639 -0.635 -1.905	155.514 -0.635 -1.270	151.389 -0.635 규정없음	155.514 +0.635 +0	151.389 +1.552 +0	159.639 +규정없음 +규정없음	3	24	7	6	25.4	35.9±0.5	<삭 제>	162	34
150	4산/ 25.4mm	152.1	179.070 -0.635 -1.905	174.945 -0.635 -1.270	170.820 -0.635 규정없음	174.945 +0.635 +0	170.820 +1.512 +0	179.070 +규정없음 +규정없음	3	24	7	6	25.4	35.9±0.5	<삭 제>	181	34

압·수 나 사

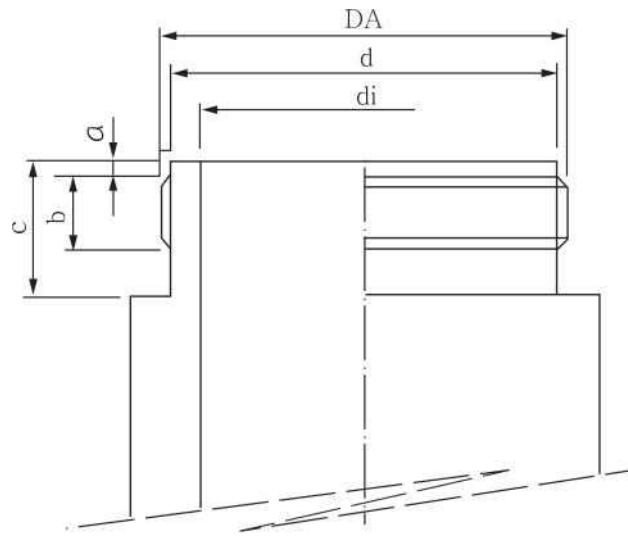

압 나 사

